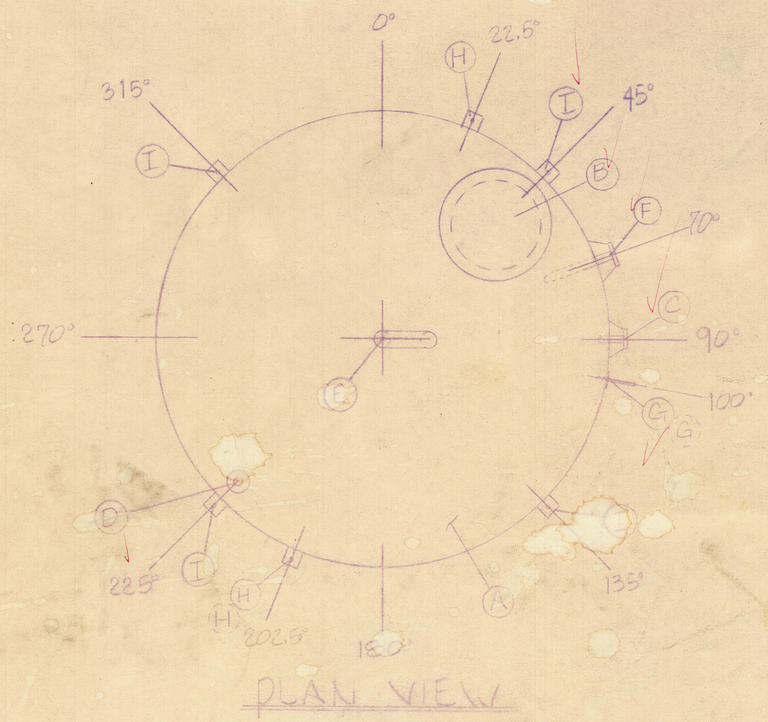

PLAN VIEW

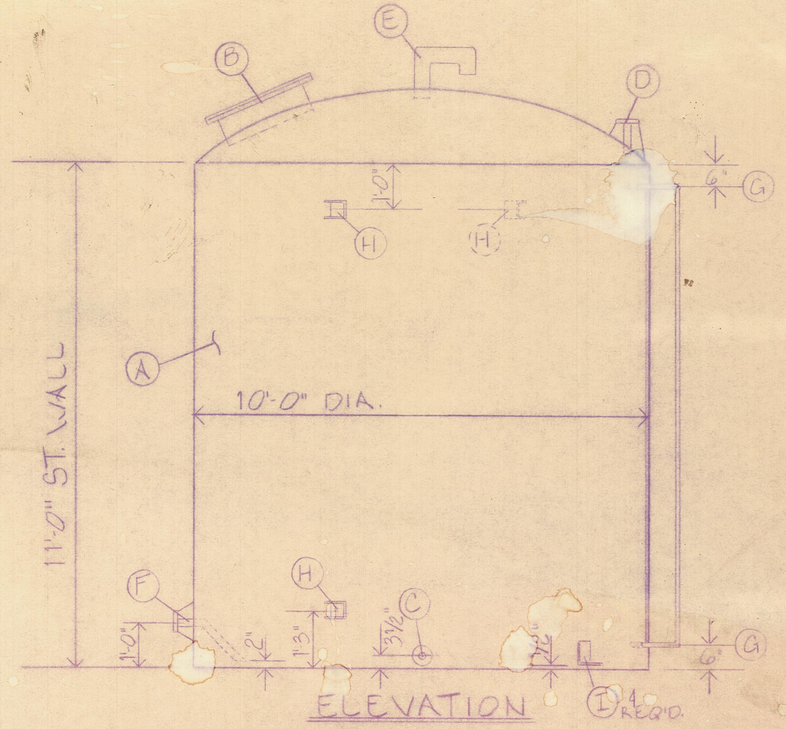

ELEVATION

(SEE PLAN FOR TRUE ORIENTATION)

MATERIAL LIST

MK	QTY	DESCRIPTION	DEG	RAD / HT
A	1	10'-0" DIA. x 11'-0" ST. WALL FRP TANK - FLAT BOTTOM - DOME TOP	–	–
B	1	24" TOP MANWAY WITH FRP COVER	45°	3'-6" R.
C	1	1½" FLANGED NOZZ. w/GUSS. - OUTLET	90°	3½" HT.
D	1	3" FLANGED NOZZ. w/GUSS. - FILL	225°	4'-6" R.
E	1	4" PVC SCH 80 GOOSENECK VENT w/SCREEN	CTR.	TOP
F	1	2" FLANGED NOZZ. w/GUSS. & SIPHON - DRAIN	70°	1'-0" HT
G	2	¾" FRP NPT COUPLINGS WITH CLEAR PVC SIGHT TUBE AND CALIBRATION STRIP (MARKED EVERY 100 GALLONS. NUMBERED EVERY 500 GALLONS).	100°	6" & 10'-6" HT.
H	3	GALV. LIFTING LUGS 2 @ / 1 @	202.5° / 22.5°	1'-9" & 10'-0" / 10'-0" HT
I	4	GALV. HOLD DOWN LUGS @ 45°, 135°, 225° & 315°	–	1/2" HT

NOTES:

1) FABRICATED WITH COREZYN 8301 OR EQUAL LINER / 150 BACK-up.
2) DOUBLE NEXUS VEIL CORROSION BARRIER.
3) PER EDWARDS FIBERGLASS STANDARDS WHICH ARE IN ACCORDANCE WITH ASTM-D 4097-88 CONTACT MOLDED
4) NOMINAL THICKNESS 5/16" AT BOTTOM TAPPERED TO 1/4" AT TOP.
5) NATURAL IN COLOR WITH U.V. ADDED.
6) NOMINAL 6,000 GALLON CAPACITY.
7) AMBIENT TEMPERATURE.
8) Sp. Gr. 1.4
9) ATMOSPHERIC PRESSURE.

LIQUID ALUM

☒ NO EXCEPTION TAKEN ☐ MAKE CORRECTIONS NOTED
☐ REJECTED ☐ REVISE AND RESUBMIT

Checking is only for general conformance with the design concept of the project and general compliance with the information given in the contract documents. Any action shown is subject to the requirements of the plans and specifications. Contractor is responsible for: Dimensions which shall be confirmed and correlated at the job site; selecting fabrication processes and techniques of construction; coordination of his work with that of all other trades and the satisfactory performance of his work.

Elrod • Dunson, Inc.

Date 3-21-94
By DR

Judy Construction Co.
BY: BD DATE: 3-15-94
☒ Reviewed
☐ Reviewed As Noted

☐ Drawing Approved, Proceed with Fabrication

☐ Revise Drawing as noted, Resubmit for Approval Prior to proceeding with Fabrication

QUALITY CONTAINMENT

EDWARDS FIBERGLASS, INC. 816-826-3915
P.O. Box 1252 • Boonville & Harding
Sedalia, Missouri 65302-1252

DATE 1.17.94	DRN JOYCE	P.O.# 93504
REVISION "A"		DATE 3.4.94
TITLE W.P. HARRIMAN, TN		NO. # 2410