SC-3956

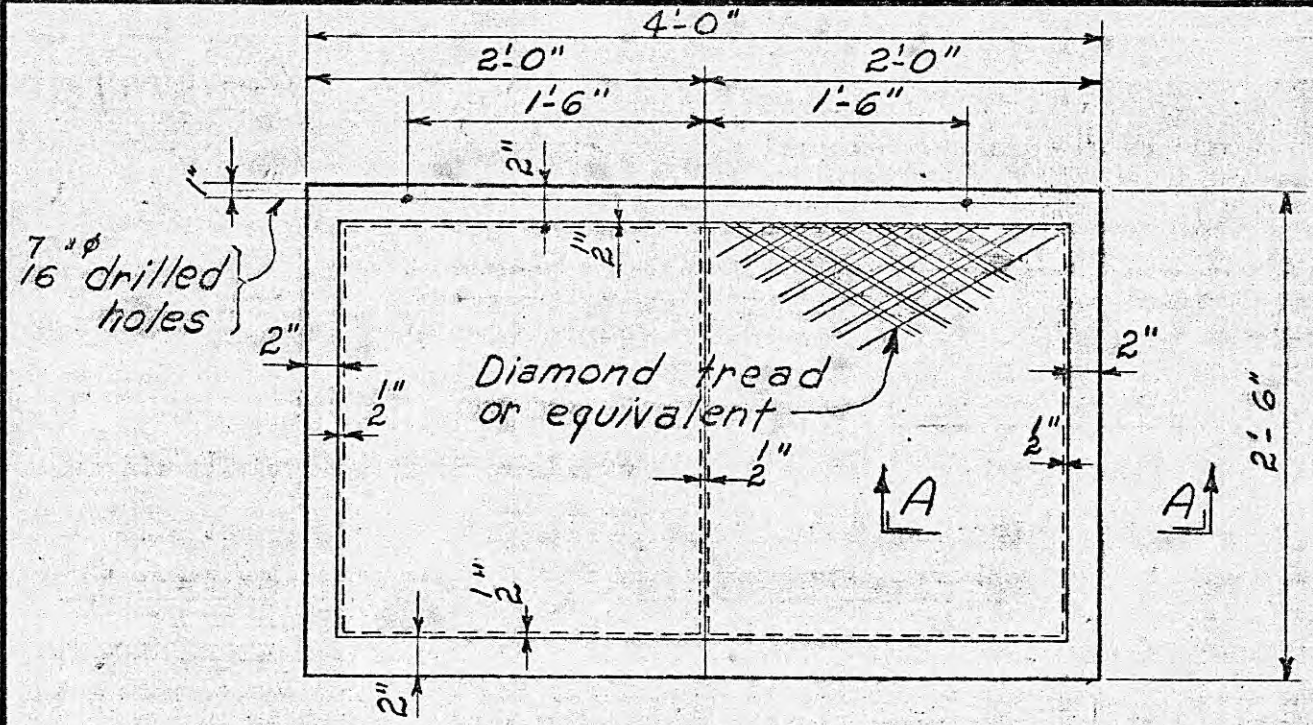

PLAN

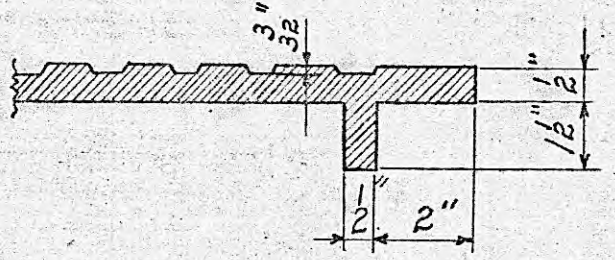

SECTION A-A

NOTE:-

Plate shall be set on the graded ground.
Paint one shop coat of oil alkyd rust inhibitive primer.
Material shall be grey cast iron per ASTM A-48 class 30.

Approx. weight, 210#

Rev. No.	DATE	DSGN	DRWN	CHKD	SUPV	APPD
9	9-16-81	WHF/A	WSC	WSC	HHH	
	Removed red lead and linseed oil.					
8	1-3-66		P.M.	RWR	RWE	WGT
	TRACED					

DSGN. D.F.
DRWN. D.F.
CHKD. W.W.P.
SUPV.
W. O.
PROJ. ENGR.

TENNESSEE VALLEY AUTHORITY
DIVISION OF POWER PLANNING AND ENGINEERING

SUBSTATIONS GENERAL
GROUNDED PLATFORM PLATE
DETAIL FOR AIR BREAK SWITCH CONTROL

DATE 4-6-37 | SUBMITTED 1-7-66 R.H. Connelly | APPROVED C.J. Brown | SHEET 1 OF 1 SHEETS
SCALE 1"=3" | CLASS. CODE 15 976 0 | SC-3956

5

MICROFILMED

R9