


LC-46515

MATERIAL REQUIRED	
QUANTITY	DESCRIPTION
6	Corner Post
128	Line Post
2	Gate Post(4"AD)
1	Gate 20' Dbl. Swin.
1278	Lin Ft. Fence Fabric
1273	Lin Ft. Top Rail
3819	Lin Ft. Barbed Wire

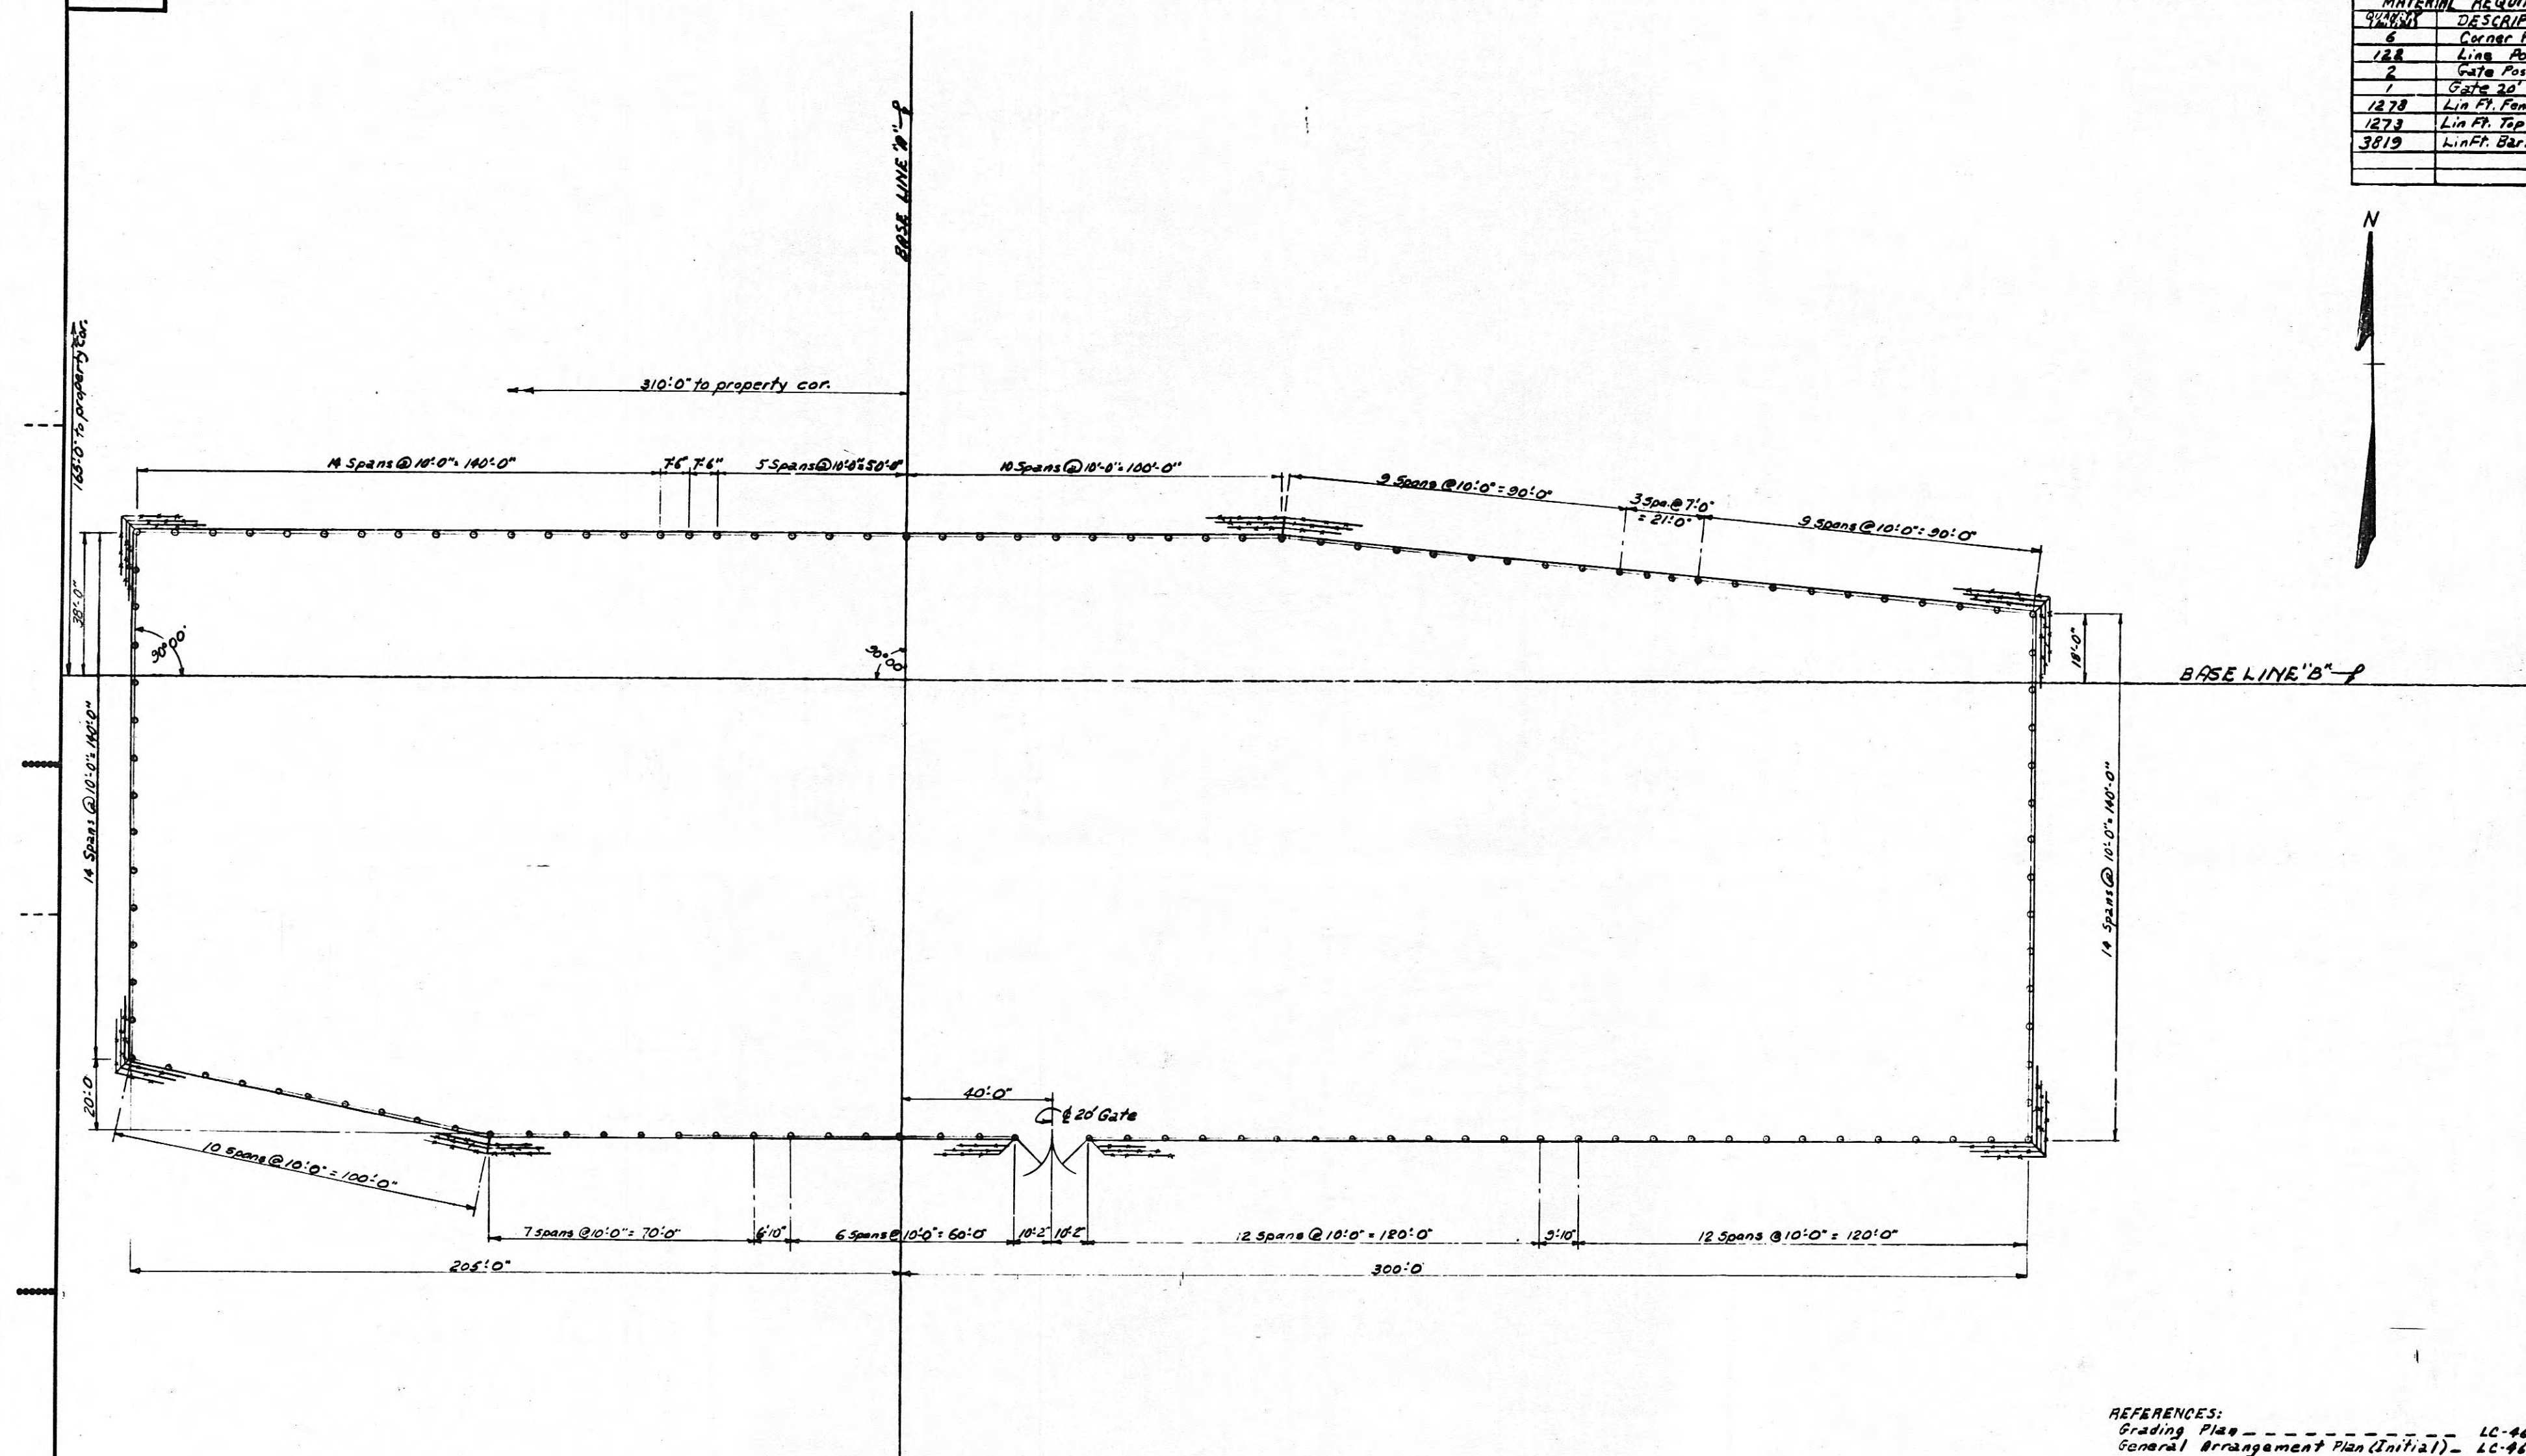

REFERENCES:
Grading Plan----- LC-46455
General Arrangement Plan (Initial)- LC-46512

TENNESSEE VALLEY AUTHORITY
 DIVISION OF POWER PLANNING AND ENGINEERING
 HARRIMAN, TENN. SUBSTATION-161KV
 FENCE PLAN

[illegible]

079376