


Regn 16656

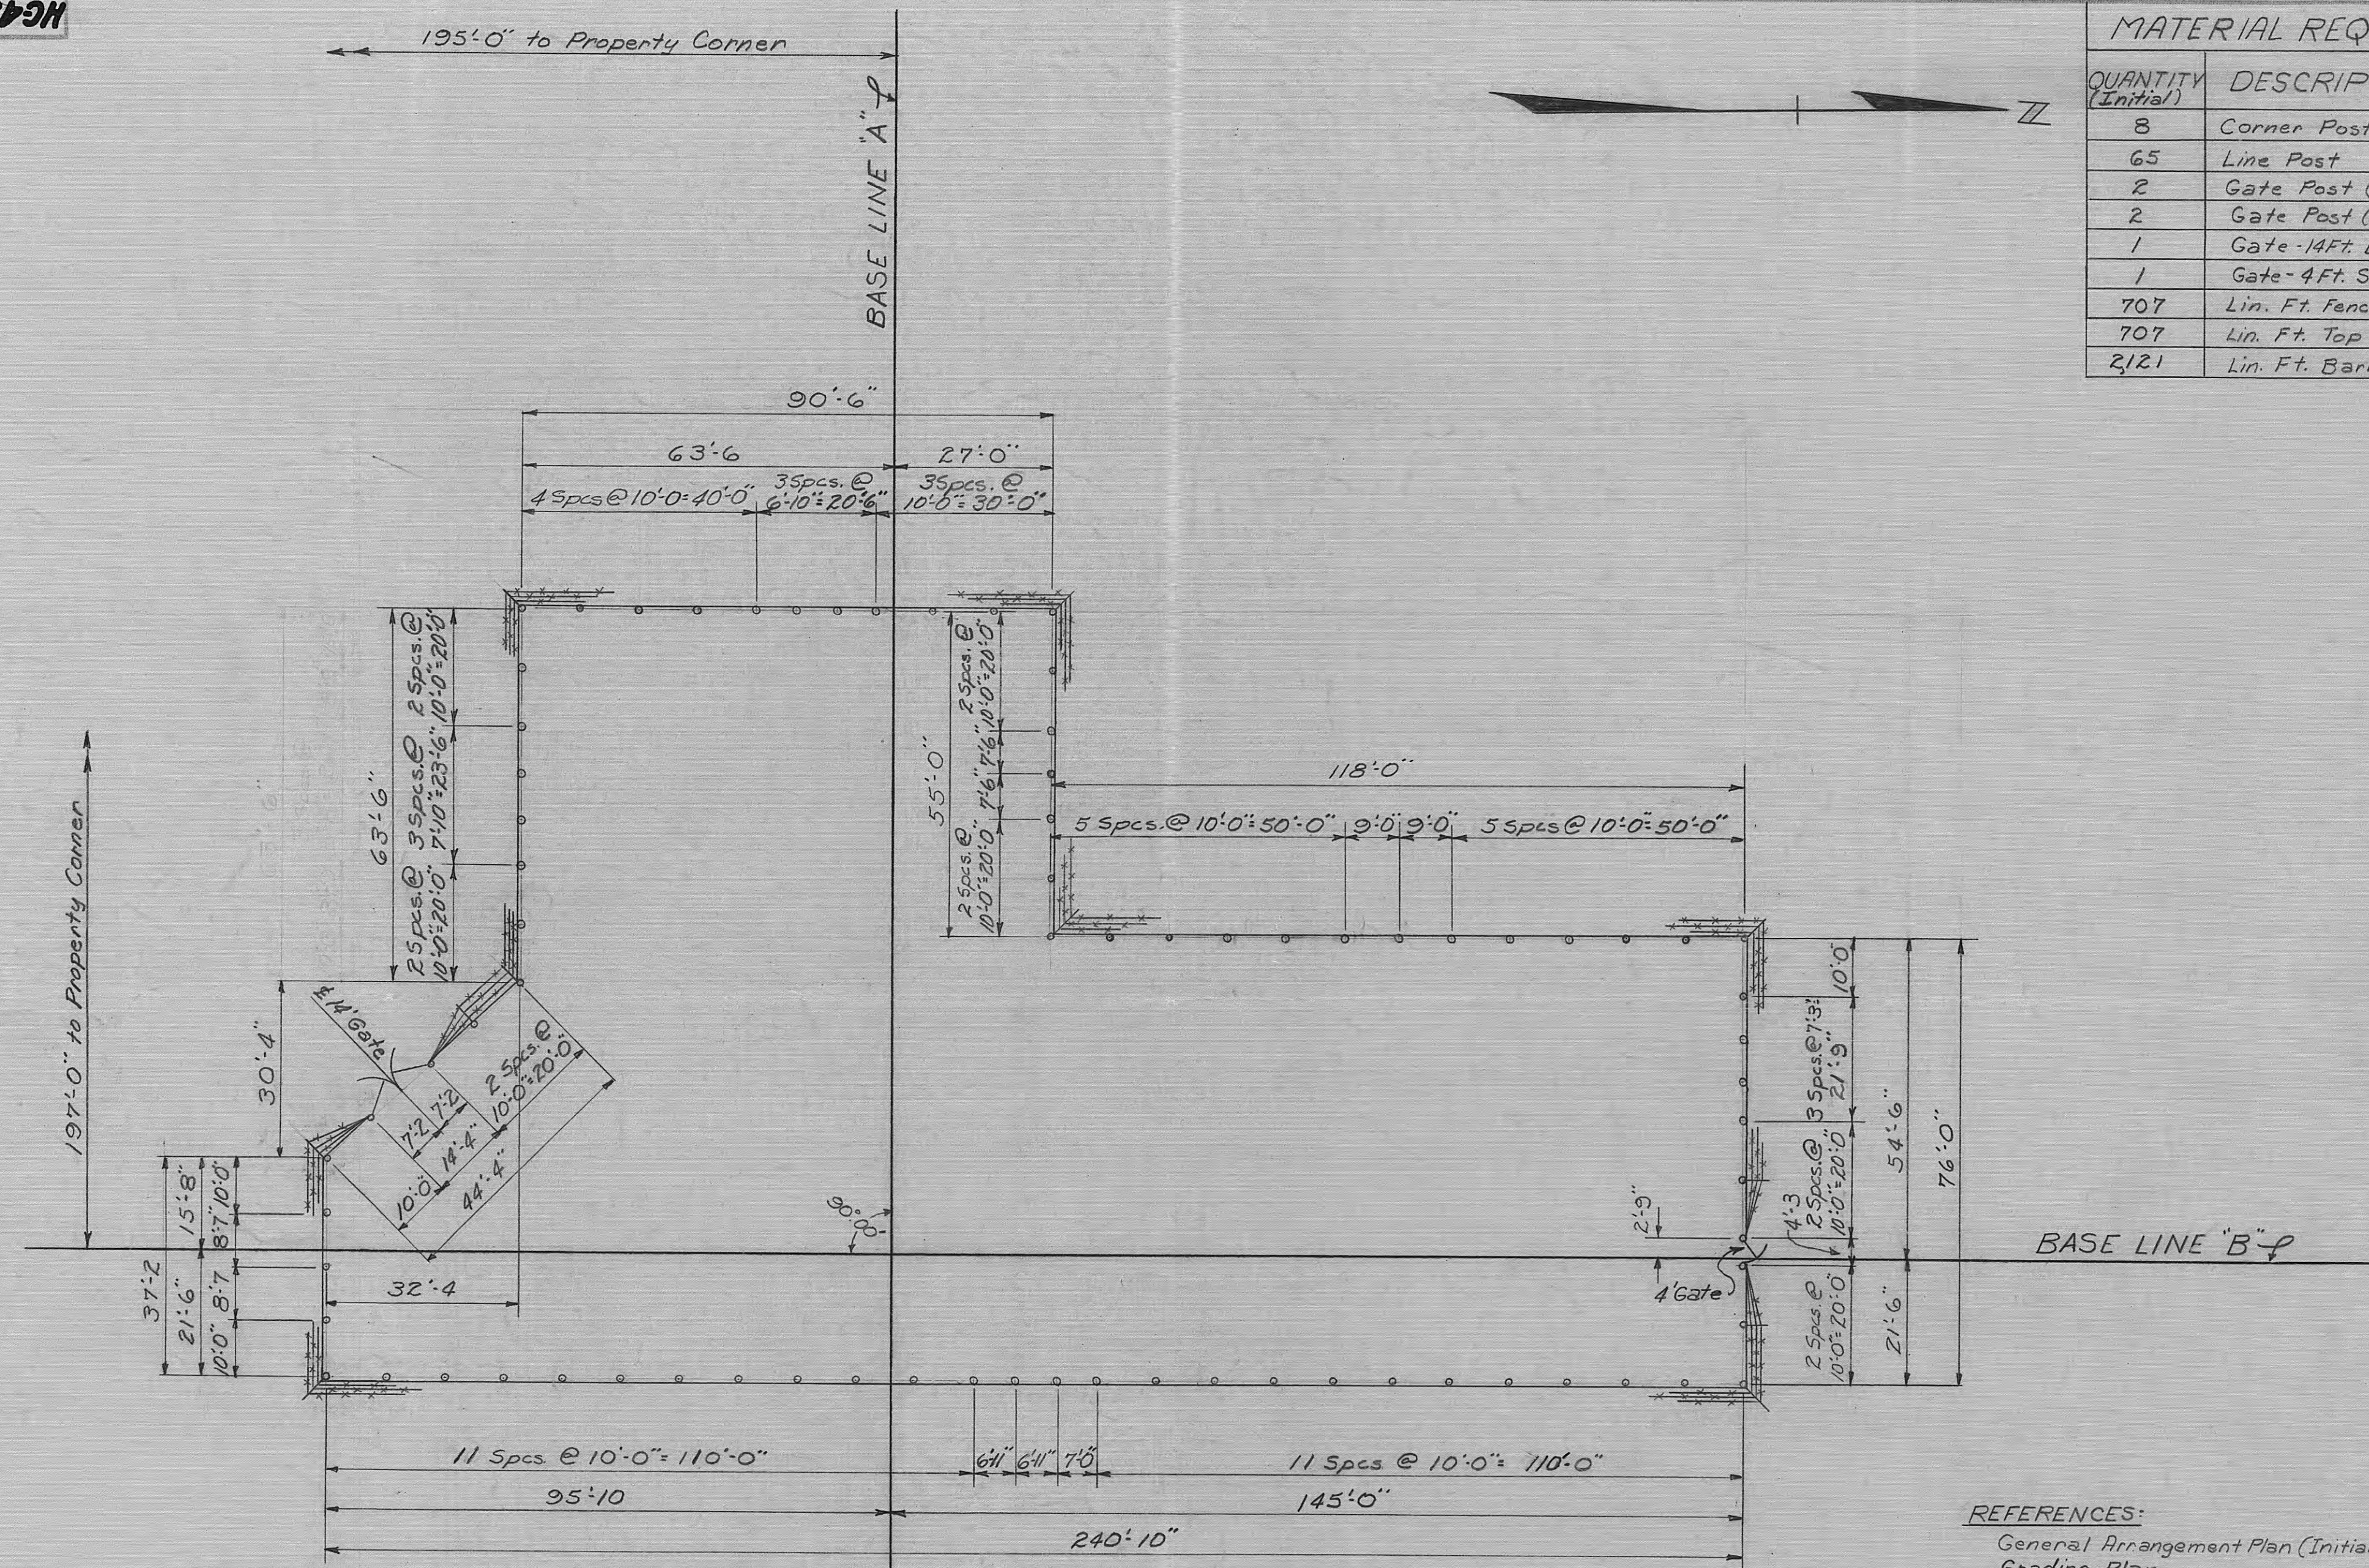

MATERIAL REQUIRED	
QUANTITY (Initial)	DESCRIPTION
8	Corner Post
65	Line Post
2	Gate Post (4" O.D)
2	Gate Post (3" O.D)
1	Gate -14Ft. Dbl. Swing
1	Gate -4Ft. Sgl. Swing
707	Lin. Ft. Fence Fabric
707	Lin. Ft. Top Rail
2/21	Lin. Ft. Barbed Wire

Aluminum (from stock)

REFERENCES:

General Arrangement Plan (Initial) LC-47897
Grading Plan LC-49591

TENNESSEE VALLEY AUTHORITY

DIVISION OF POWER PLANNING AND ENGINEERING

N.E. HARRIMAN, TENN. SUBSTATION-69KV
FENCE PLAN

[illegible]

DATE	5-27-63	SUBMITTED	<i>Frank A. Smith</i>
SCALE	1" = 20'-0"	CLASS. CODE	A304

APPROVED

Edw. H. Smith

SHEET / OF / SHEETS

HC-49683 R-0

MICROFILMED *ca*