



CONSOLIDATED TECHNOLOGIES, INC.
401 CHESTNUT STREET, SUITE 220
CHATTANOOGA, TN 37402

DESIGNER: AS DATE:

PROJECT NO.: 91017


CHECKED: CONSTR DATE:

SHEET ____ OF ____

CLIENT: *Oakdale/Wolfe Branch U.D. Water Line Replacement Phase 3*

SUBJECT: *4" Coupling & 22 1/2° Bend on 4" PVC Line along Camp Austin Road at County Road
Near R.F. Eble & Langley homes.*

4-92 D.K.

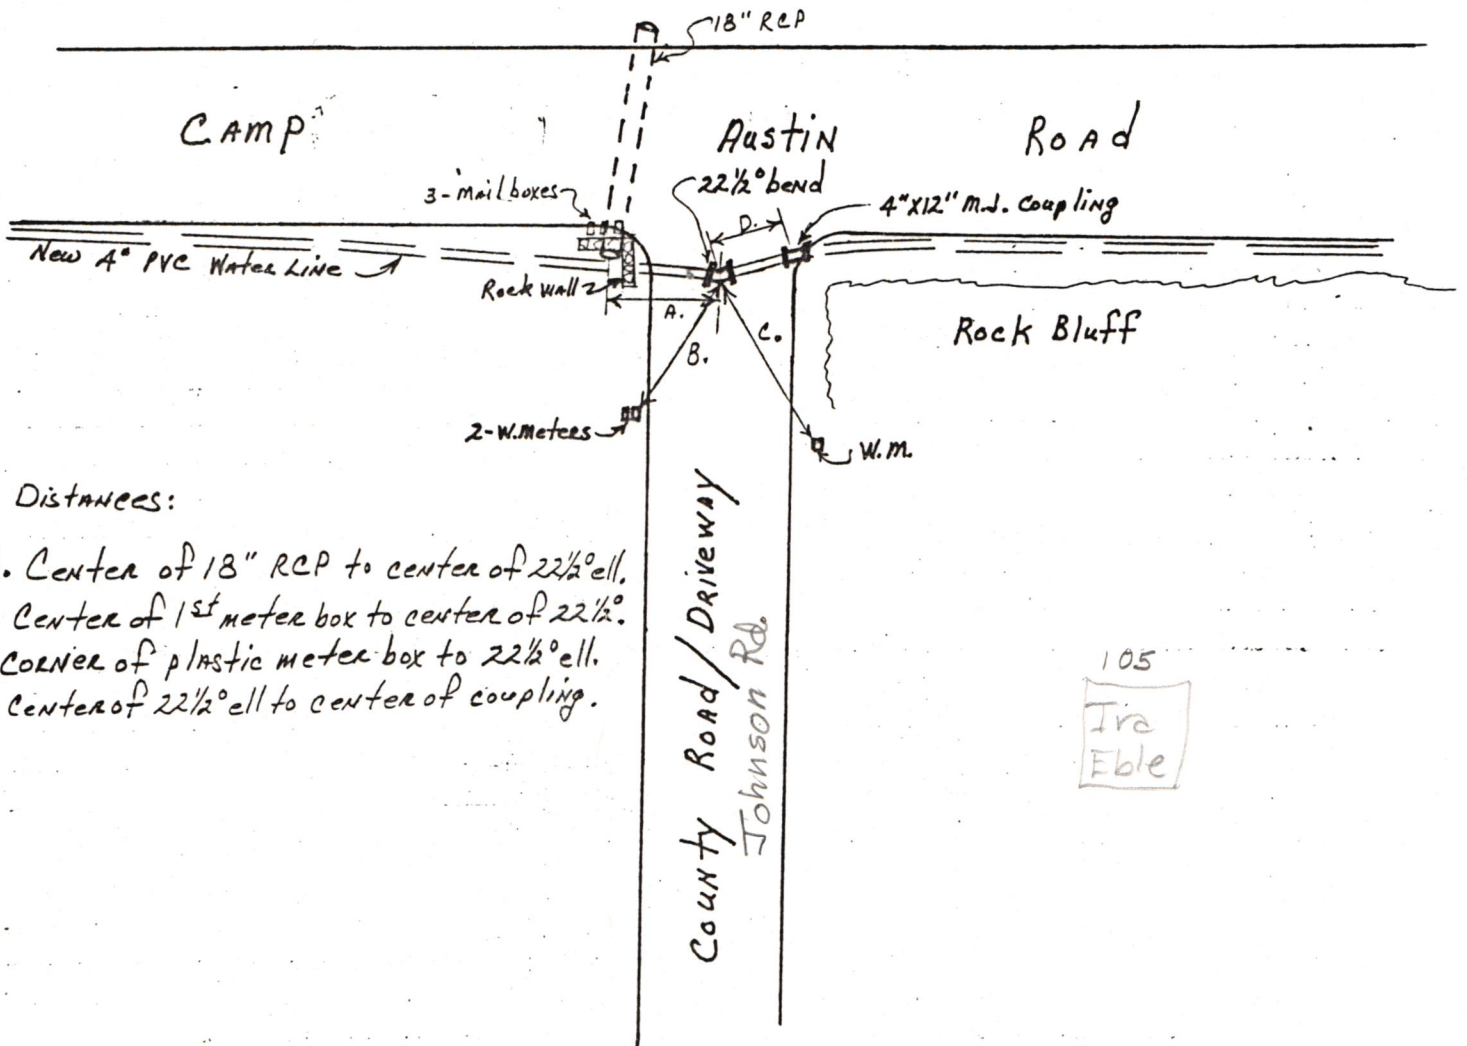

Distances:

- 11'-6" A. Center of 18" RCP to center of 22 1/2° ell.
- 29'-0" B. Center of 1st meter box to center of 22 1/2°.
- 32'-6" C. CORNER of plastic meter box to 22 1/2° ell.
- 5'-6" D. Center of 22 1/2° ell to center of coupling.

105
Ira Eble